


PLAN

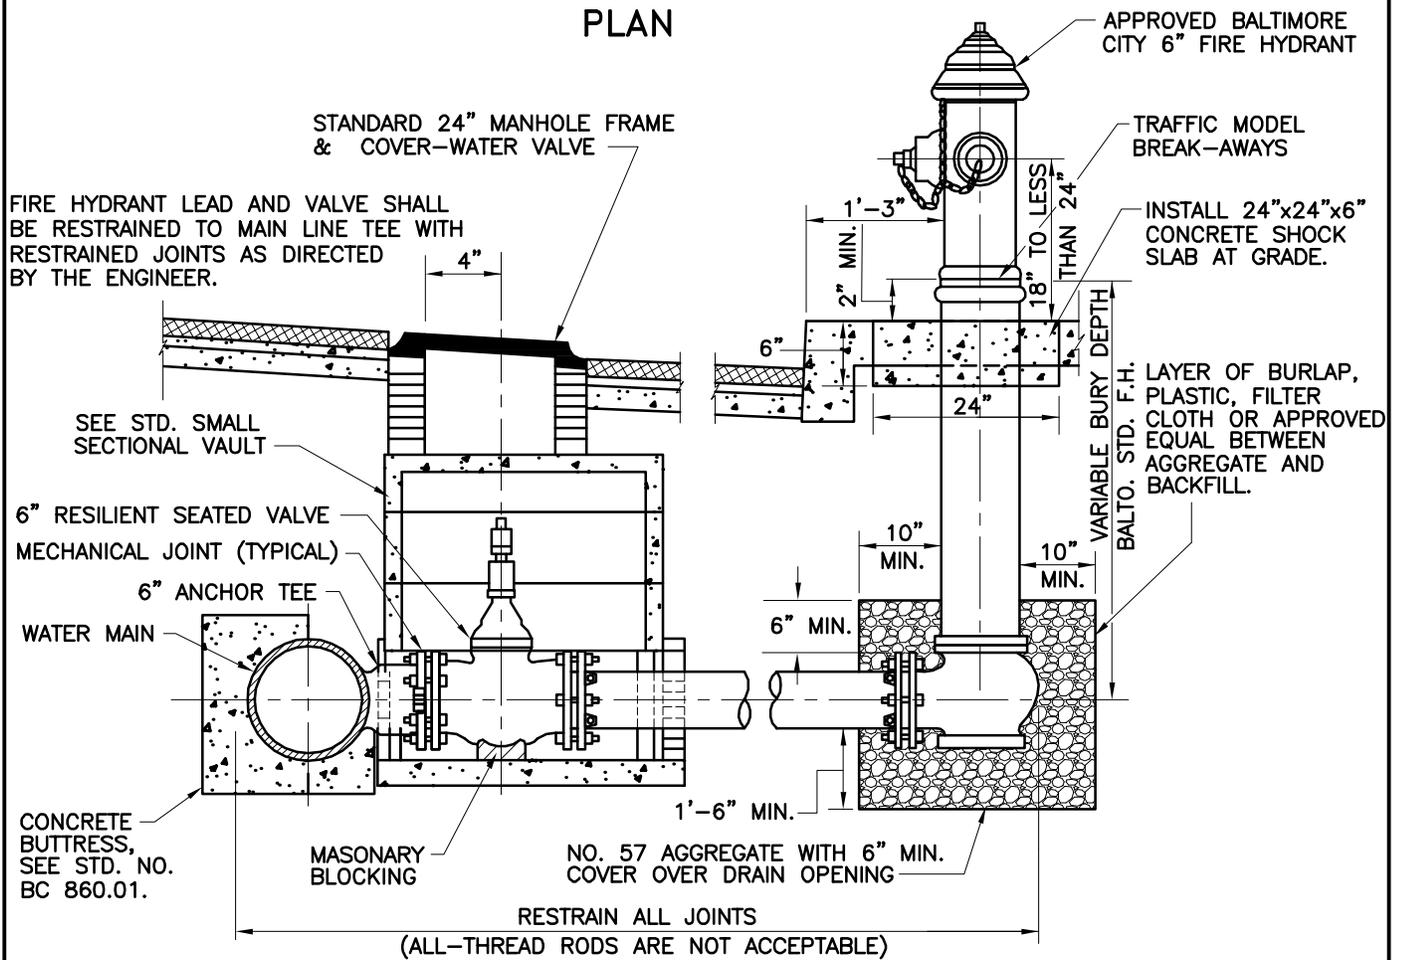

- NOTES: 1. BALTIMORE STANDARD FIRE HYDRANT HAS VARIABLE BURY DEPTH, ANY VERTICAL ADJUSTMENT SHALL BE MADE USING BALTIMORE STD. FIRE HYDRANT EXTENSION PIECES.
2. CONCRETE SHALL BE MIX 3.

SECTION A-A

|   |  |   |                           |              |         |
|---|--|---|---------------------------|--------------|---------|
|  | APPROVED:<br><br>HEAD, BUREAU OF WATER AND WASTEWATER | CITY OF BALTIMORE<br>DEPARTMENT OF PUBLIC WORKS<br>BUREAU OF WATER AND WASTEWATER | ISSUED                    | REVISED      | REVISED |
|   | <br>DIRECTOR, DEPARTMENT OF PUBLIC WORKS              |   | 3 / 2008                  |              |         |
|   | STANDARD INSTALLATION<br>OF FIRE HYDRANT<br>WITH TEE AND VALVE<br>(SECTIONAL VAULT)  |   | STANDARD NO.<br>BC 833.01 |              |         |
|   |  |   | SCALE: NONE               | SHEET 1 OF 1 |         |