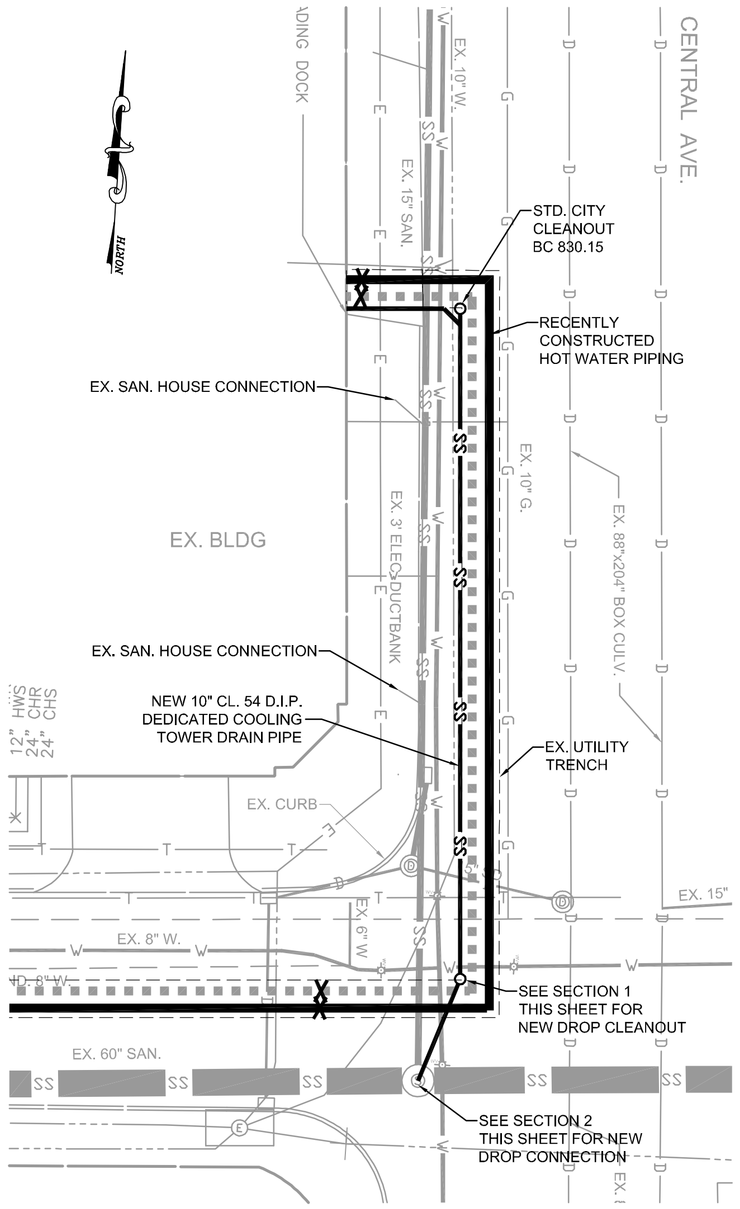

SITE PLAN

SCALE: 1"=20'

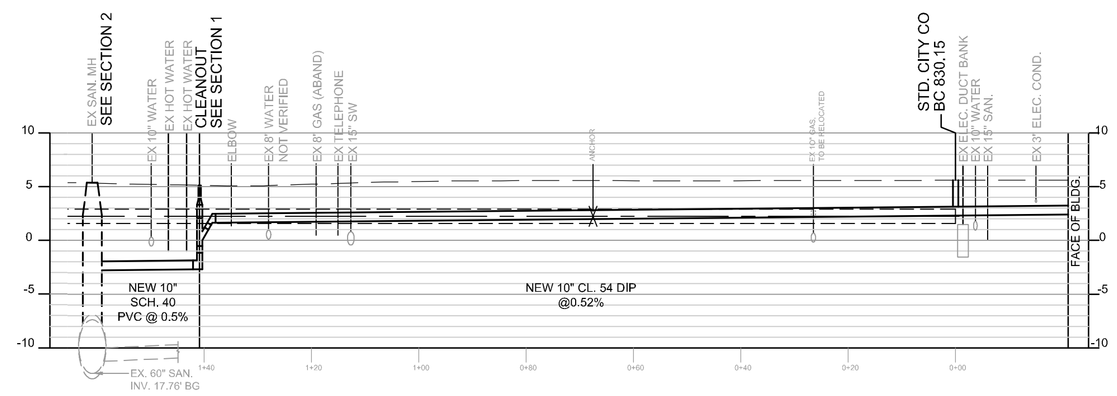

NOTE: THE PROPOSED 10" DIP SHALL BE ENCASED IN 2 LAYERS OF LOW DENSITY POLYETHYLENE ENCASEMENT MEETING THE REQUIREMENTS OF AWWA C105 (ANSI A21.5)

PROFILE

SCALE: HORIZ. 1"=20'
VERT. 1"=10'

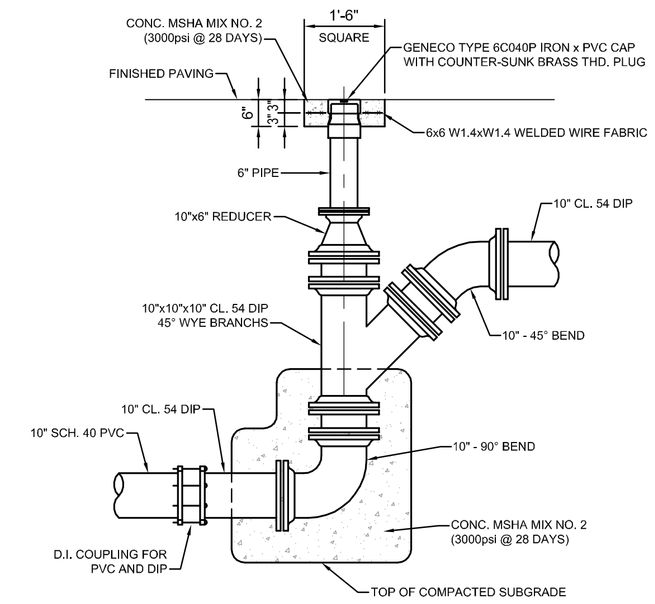

SECTION 1 - DROP CLEANOUT

SCALE: ½" = 1'-0"

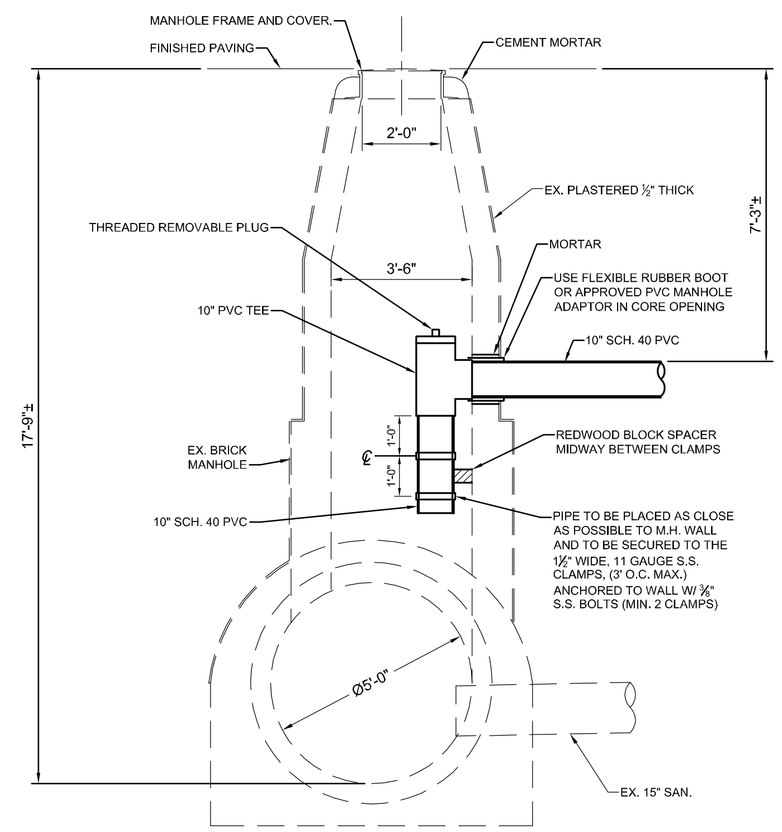

SECTION 2 - EXISTING MANHOLE SHOWING NEW DROP CONNECTION

SCALE: ⅜" = 1'-0"

PROFESSIONAL CERTIFICATION:
I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND, LICENSE No. EXPIRATION DATE:

THIS DRAWING AND THE DESIGN AND CONSTRUCTION FEATURES DISCLOSED ARE PROPRIETARY TO GIPE ASSOCIATES, INC. AND SHALL NOT BE ALTERED OR REUSED IN WHOLE OR IN PART WITHOUT THE EXPRESS WRITTEN PERMISSION OF GIPE ASSOCIATES, INC. Copyright © 2011

Gipe Associates Inc.
Consulting Engineers
849 Fairmount Ave Suite 102 Baltimore, MD 21286
Baltimore, Maryland (410)832-2420
Easton, Maryland (410)822-8688
W.O.# 11104

WHITNEY BAILEY COX & MAGNANI, LLC
849 Fairmount Ave. Suite 100 Baltimore, MD 21286
Tel. 410-512-4500 Fax. 410-356-4100
www.wbcm.com
WBCM
ARCHITECTURE ENGINEERING CONSTRUCTION

STAMP

VEOLIA ENERGY
1400 RIDGELY STREET
BALTIMORE, MARYLAND 21230

PROJECT TITLE:
INNER HARBOR EAST HIGH TEMP HOT WATER RELOCATION

DRAWING TITLE:
1001 FLEET STREET
DEDICATED COOLING TOWER DRAINAGE LINE

DESIGNED BY:	B.W.L.	GAI PROJ. NO.:	—
DRAWN BY:	H.H.		
CHECKED BY:	B.W.L.	DRAWING NO.:	
APPROVED BY:	PD		
SCALE:	AS NOTED		
DATE:	12-08-2011		