


ELEVATION



SECTION A-A

NOTE:  
 SEE DPW BUTTERFLY VALVE  
 SPECIFICATION FOR ALL BUTTERFLY  
 VALVES 30"-72"

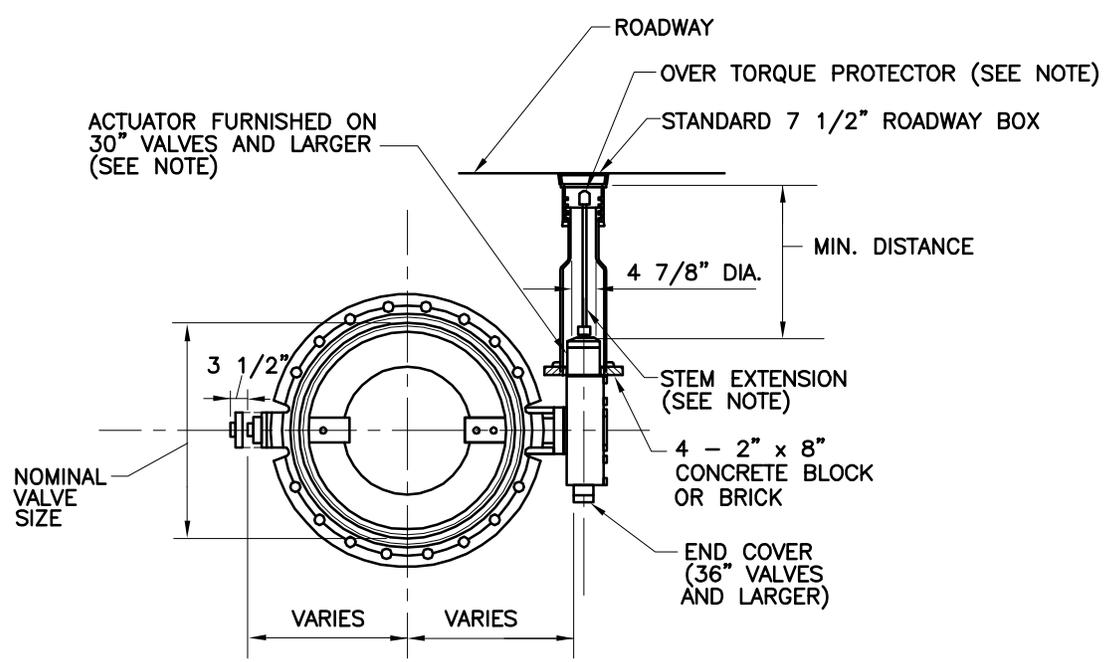

APPROVED :  
*[Signature]*  
 HEAD, BUREAU OF WATER AND WASTEWATER  
*[Signature]*  
 DIRECTOR, DEPARTMENT OF PUBLIC WORKS

CITY OF BALTIMORE  
 DEPARTMENT OF PUBLIC WORKS  
 BUREAU OF WATER AND WASTEWATER  
 STANDARD INSTALLATION  
 OF BUTTERFLY VALVE  
 WITH ROADWAY BOX  
 (30" - 72")

ISSUED	REVISED	REVISED
3 / 2008		
<b>STANDARD NO. BC 835.02</b>		
SCALE : NONE		SHEET 1 OF 1