


# DUCT IDENTIFICATION

## I. GENERAL

The following method and associated rules have been established to prevent confusion and inconsistencies in the identification of ducts. This method has been reviewed and found acceptable and satisfactory by Baltimore City and Baltimore Gas and Electric Company.

The following diagram illustrates the proper method to use to count ducts when facing in the indicated direction. It is to be noted that the counting is started from the east duct in the bottom row when facing either north or south, and from the south duct in the bottom row, when facing either east or west.

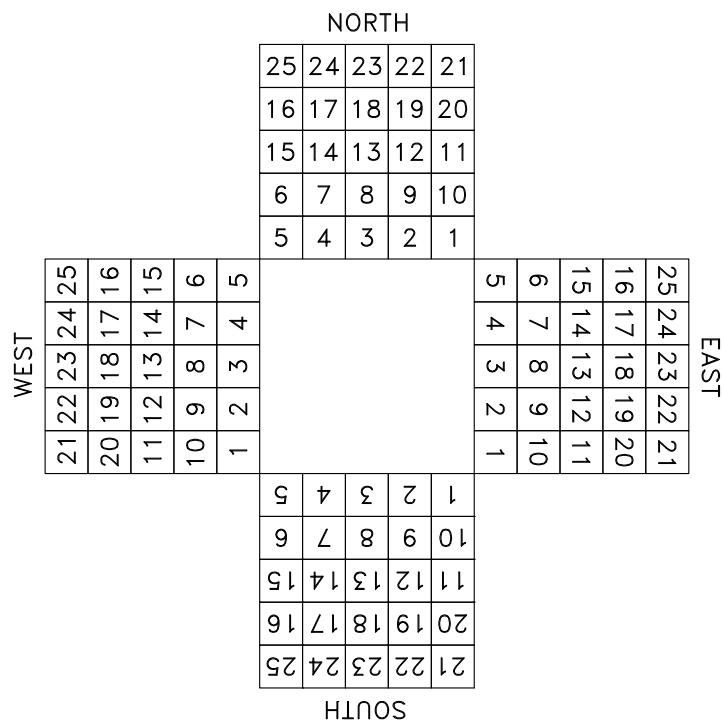

To correctly identify a duct it is necessary to determine the following:

- A. The direction of the line.
- B. Whether it is a trunk or distribution line.
- C. The manhole which each duct group supplies.



APPROVED:

*Richard L. Baker*  
CHIEF, CONDUIT DIVISION  
*Khalil Zane*  
DIRECTOR, DEPARTMENT OF TRANSPORTATION

CITY OF BALTIMORE  
DEPARTMENT OF TRANSPORTATION  
CONDUIT DIVISION

DUCT IDENTIFICATION

ISSUED	REVISED	REVISED
8 / 2010		

STANDARD NO.  
BC 830.01-1

SCALE : NONE

SHEET 1 OF 6