



PLAN

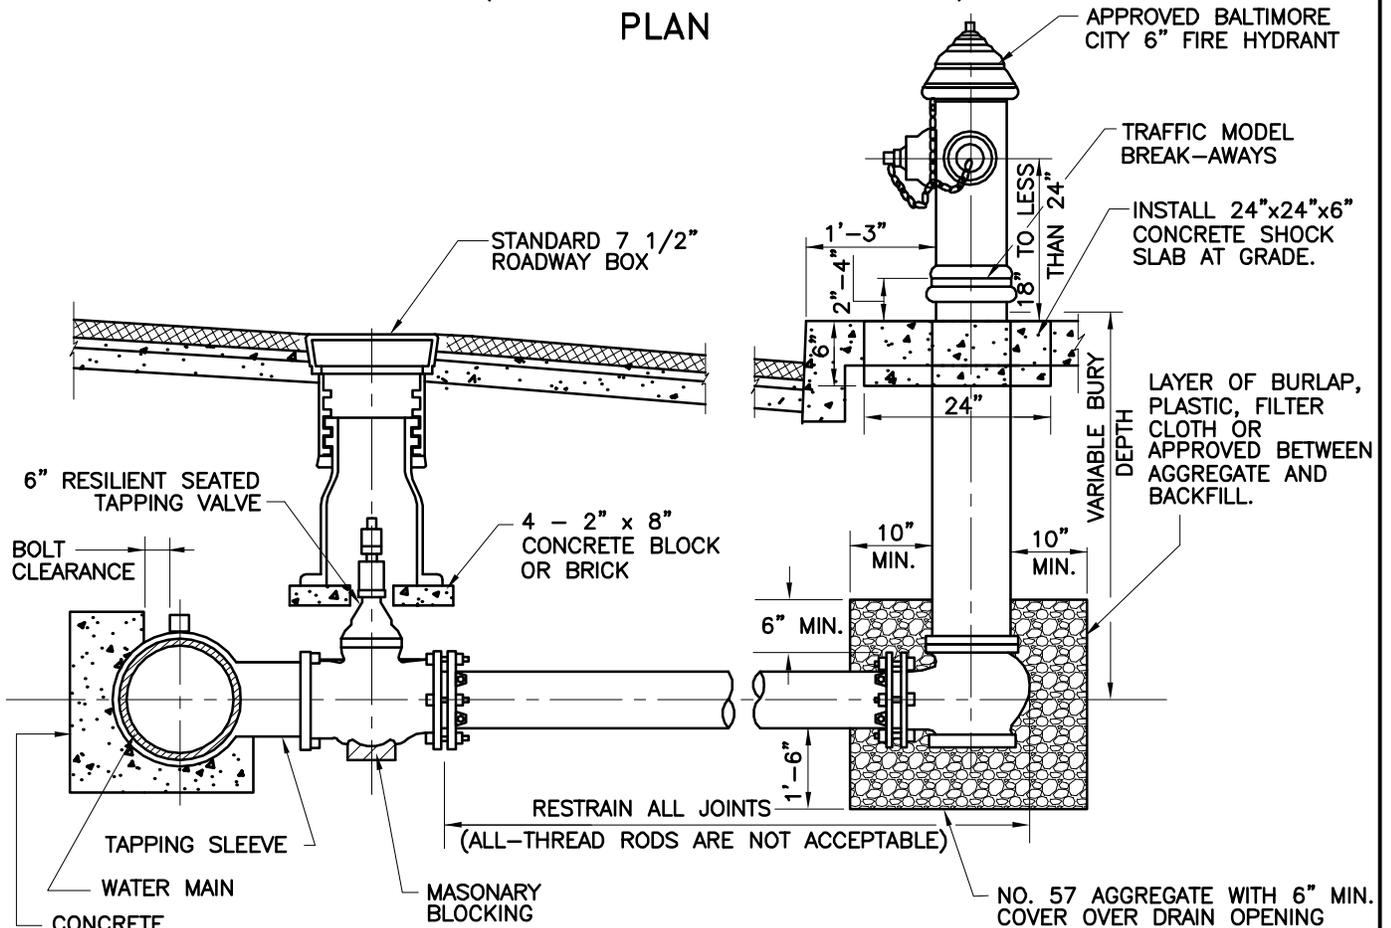

ELEVATION

- NOTES: 1. BALTIMORE STANDARD FIRE HYDRANT HAS VARIABLE BURY DEPTH, ANY VERTICAL ADJUSTMENT SHALL BE MADE USING BALTIMORE STD. FIRE HYDRANT EXTENSION PIECES.
 2. CONCRETE SHALL BE MIX 3.



APPROVED:
[Signature]
 HEAD, BUREAU OF WATER AND WASTEWATER
[Signature]
 DIRECTOR, DEPARTMENT OF PUBLIC WORKS

CITY OF BALTIMORE
 DEPARTMENT OF PUBLIC WORKS
 BUREAU OF WATER AND WASTEWATER
 STANDARD INSTALLATION
 OF FIRE HYDRANT WITH
 TAPPING SLEEVE AND VALVE
 (ROADWAY BOX)

ISSUED	REVISED	REVISED
3 / 2008		
STANDARD NO. BC 833.04		
SCALE: NONE	SHEET 1 OF 1	