


PLAN (METER VAULT ONLY)

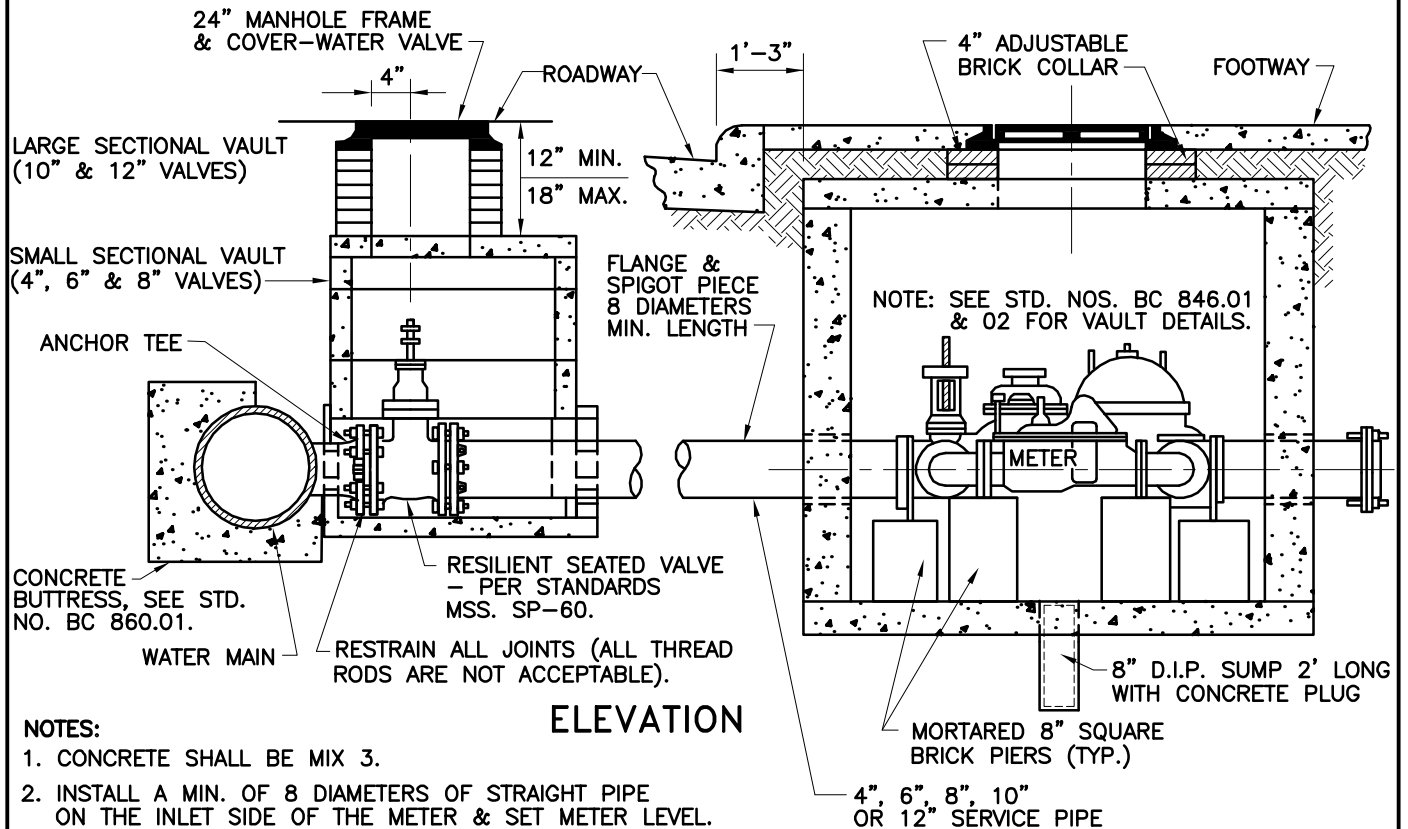

ELEVATION

NOTES:

1. CONCRETE SHALL BE MIX 3.
2. INSTALL A MIN. OF 8 DIAMETERS OF STRAIGHT PIPE ON THE INLET SIDE OF THE METER & SET METER LEVEL.



APPROVED:

[Signature]
HEAD, BUREAU OF WATER AND WASTEWATER

[Signature]
DIRECTOR, DEPARTMENT OF PUBLIC WORKS

CITY OF BALTIMORE
DEPARTMENT OF PUBLIC WORKS
BUREAU OF WATER AND WASTEWATER

STANDARD INSTALLATION OF
4", 6", 8", 10", & 12" FIRE SUPPLY SERVICES
WITH WATER SUPPLY SERVICE
(OUTSIDE FIRE HYDRANTS) WITH
TEE AND VALVE (SECTIONAL VAULT)

ISSUED	REVISED	REVISED
3 / 2008		

STANDARD NO.
BC 850.01

SCALE: NONE

SHEET 1 OF 1