


PLAN (METER VAULT ONLY)

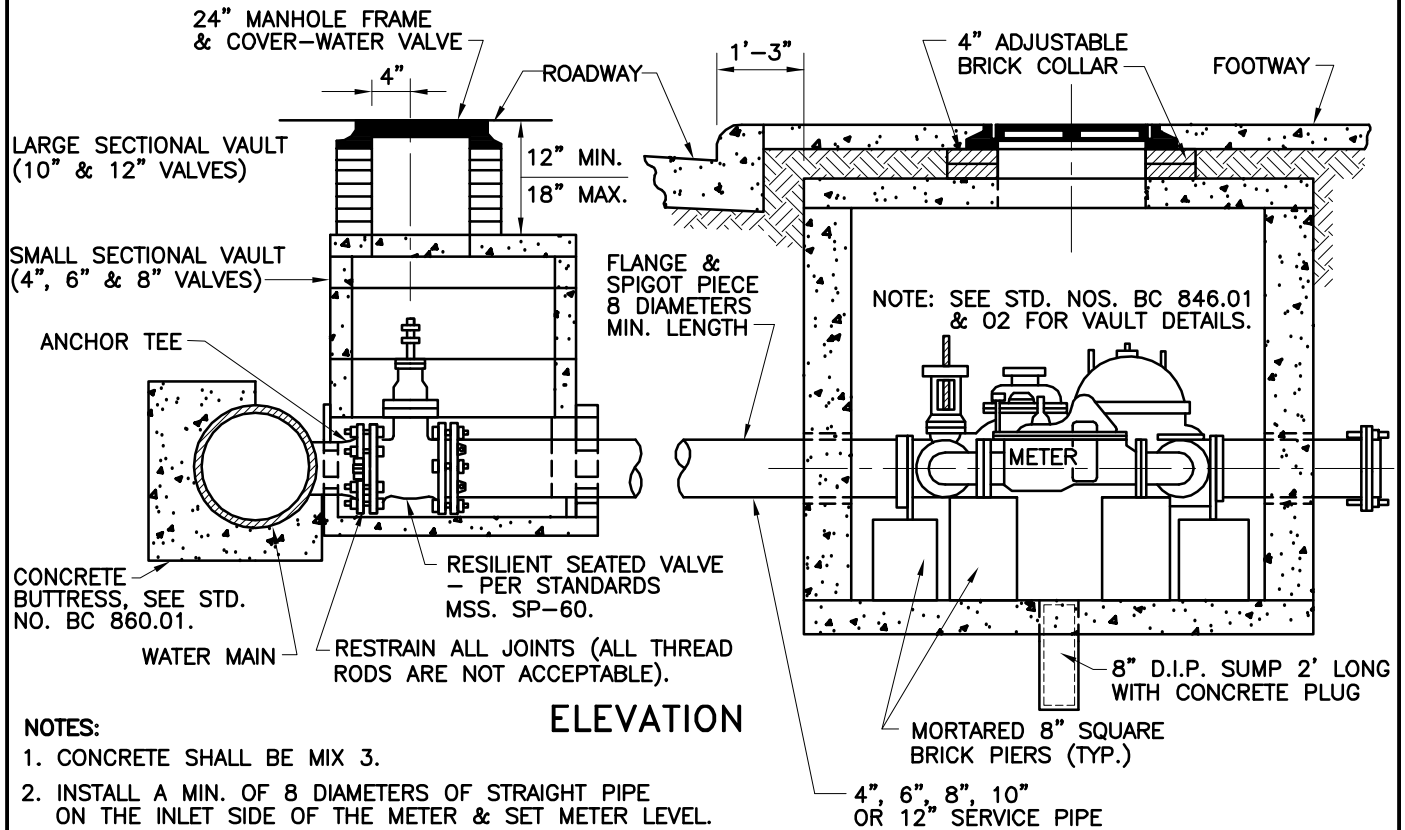

ELEVATION

NOTES:

1. CONCRETE SHALL BE MIX 3.
2. INSTALL A MIN. OF 8 DIAMETERS OF STRAIGHT PIPE ON THE INLET SIDE OF THE METER & SET METER LEVEL.



APPROVED: *[Signature]*
 HEAD, BUREAU OF WATER AND WASTEWATER
[Signature]
 DIRECTOR, DEPARTMENT OF PUBLIC WORKS

CITY OF BALTIMORE
 DEPARTMENT OF PUBLIC WORKS
 BUREAU OF WATER AND WASTEWATER

STANDARD INSTALLATION OF
 4", 6", 8", 10", & 12" FIRE SUPPLY SERVICES
 WITH WATER SUPPLY SERVICE
 (OUTSIDE FIRE HYDRANTS) WITH
 TEE AND VALVE (SECTIONAL VAULT)

ISSUED	REVISED	REVISED
3 / 2008		
STANDARD NO. BC 850.01		
SCALE: NONE		SHEET 1 OF 1